


# 7604D 125VDC AXC

REVISIONS			
LTR	DESCRIPTION	DATE	APP'D

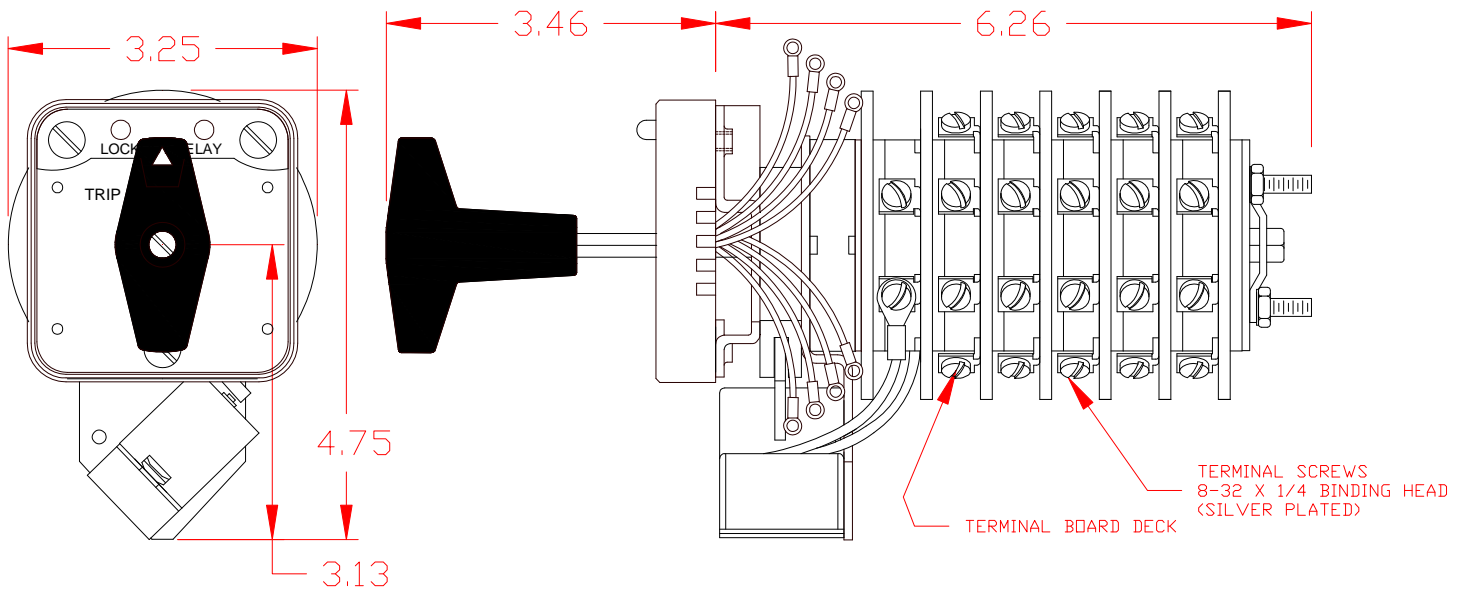

**SPECIFICATIONS:**

NO. OF POSITIONS: 2, TRIP AND RESET  
 NO. OF SECTIONS: 4  
 CONTACTS: 2 NORMALLY OPEN  
 2 NORMALLY CLOSED  
 PER DECK  
 ACTION: 45° POSITIVE TRIP DETENT  
 STATIONARY CONTACTS : SILVER OVER COPPER  
 NAMEPLATE: AS SHOWN

**COIL SPECIFICATIONS:**

OPERATING VOLTAGE: 125 VDC / 120 VAC  
 THRESHOLD VOLTAGE: 16 VDC / 20 VAC  
 OPERATING RANGE: 30 - 140 VDC / 30 - 140 VAC  
 CURRENT AT RATED VOLTAGE: 4.6 / 4.4 AMPS

**ELECTRICAL RATINGS:**

25 A/120 VAC 3 A/ 125 VDC  
 15 A/600 VAC 1 A/ 250 VDC  
 20 A/600 VAC (RESISTIVE)

**OVERLOAD CURRENT (50 OPERATIONS):**

95 A/120 VAC  
 65 A/240 VAC  
 35 A/600 VAC

DIELECTRIC STRENGTH: 2200 VRMS

INSULATION RESISTANCE: 100 MEGOHMS INITIAL

CONTACT RESISTANCE: 10 MILLIOHMS MAX. INITIAL

DECK	CONTACTS	POSITION	
		TRIP	RESET
1	11 —  —   — 13		
	12 —  —   — 18		
	15 —  —   — 17		
	16 —  —   — 14		
2	21 —  —   — 23		
	22 —  —   — 28		
	25 —  —   — 27		
	26 —  —   — 24		
3	31 —  —   — 33		
	32 —  —   — 38		
	35 —  —   — 37		
	36 —  —   — 34		
4	41 —  —   — 43		
	42 —  —   — 48		
	45 —  —   — 47		
	46 —  —   — 44		

DESCRIPTION  
**LOCK-OUT RELAY SPECIFICATION SHEET**


DRAWN P.DORMAN 8-7-08  
 SCALE .5X  
 PART NUMBER  
**7604D 125VDCAXC**



308 COMPONENTS DRIVE  
 SMITHFIELD, NC 27577 USA

# 7604D 125VDC AXC

REVISIONS		DATE	APP'D
LTR	DESCRIPTION		

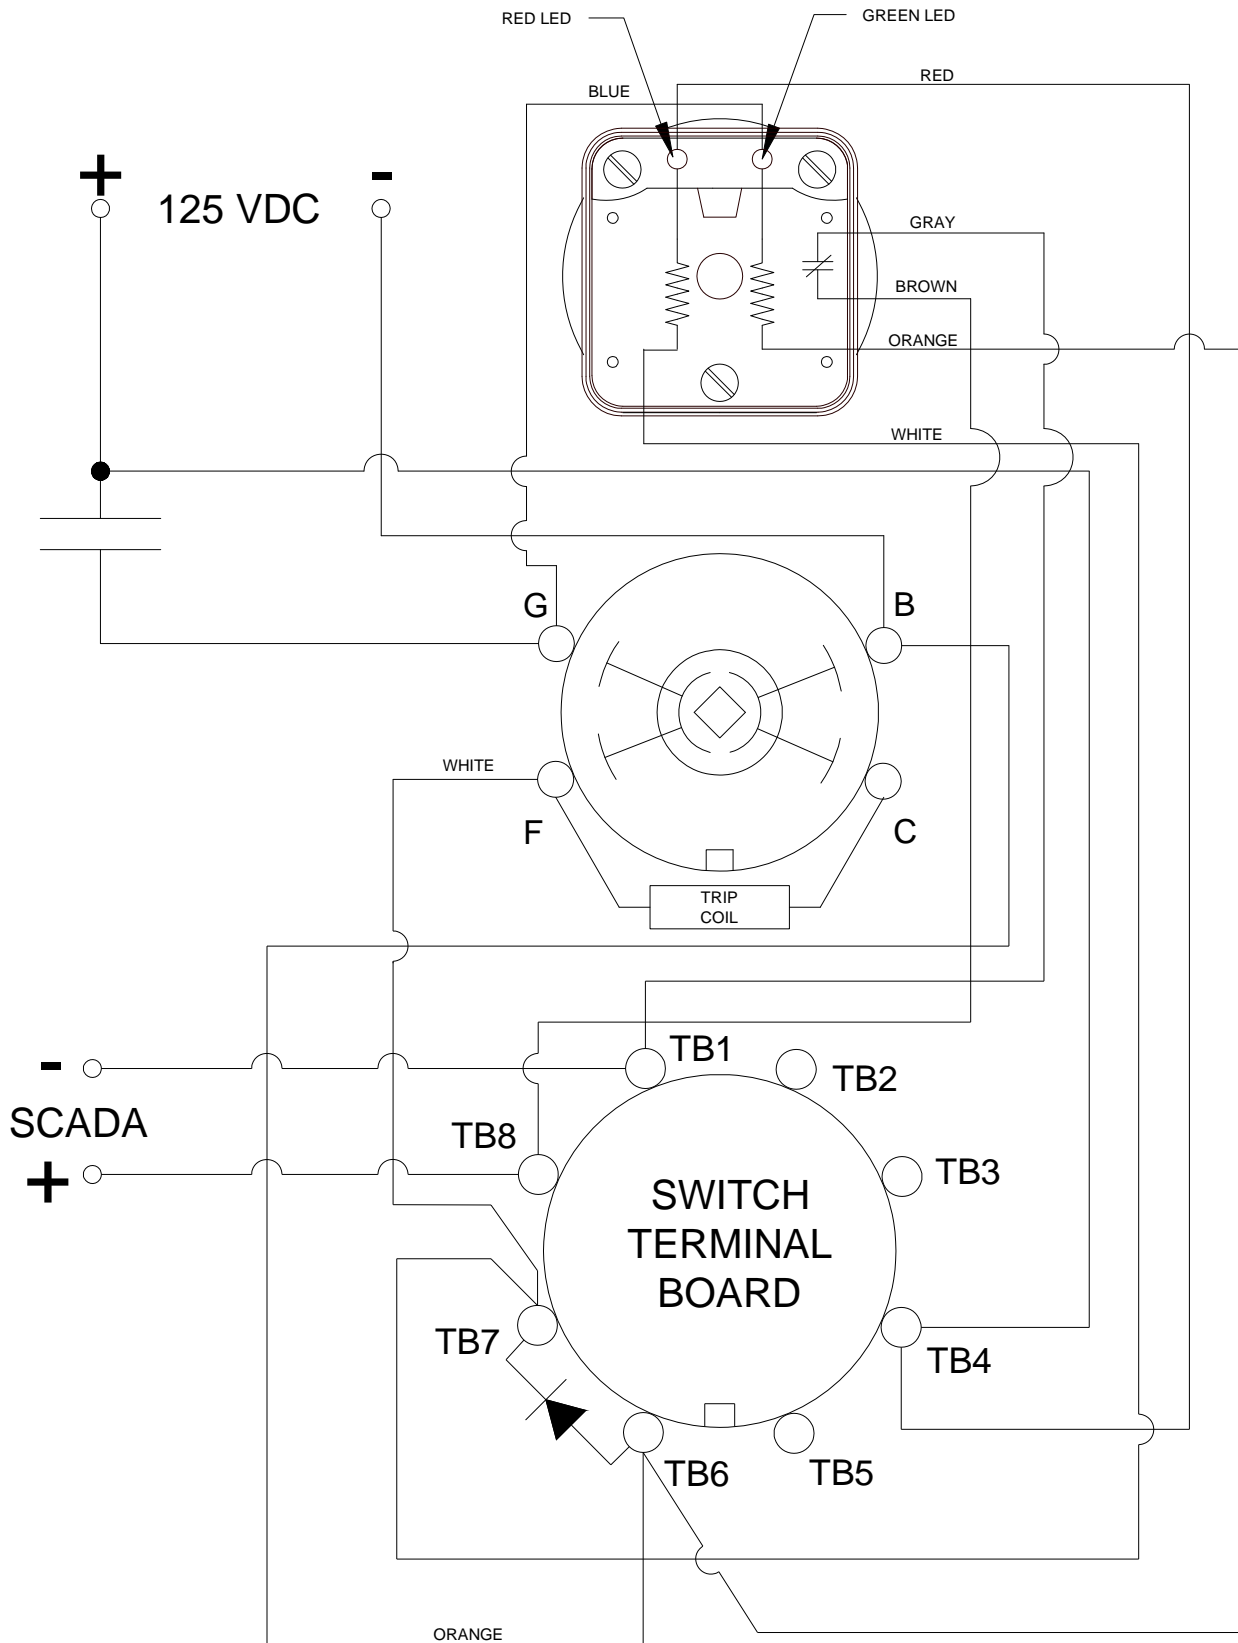

DESCRIPTION LIGHTED ESCUTCHEON PANEL  
WIRING DIAGRAM

DRAWN P.DORMAN 8-7-08

SCALE .5X

PART NUMBER

7604D 125VDCAXC




308 COMPONENTS DRIVE  
SMITHFIELD, NC 27577 USA

## LOCK-OUT RELAYS (LOR)

### GENERAL OPERATION:

THE HANDLE OF THE LOR MUST BE MANUALLY ROTATED CLOCKWISE TO PLACE THE UNIT IN THE "RESET" POSITION (SEE FIGURE A)

FIGURE A - RESET POSITION

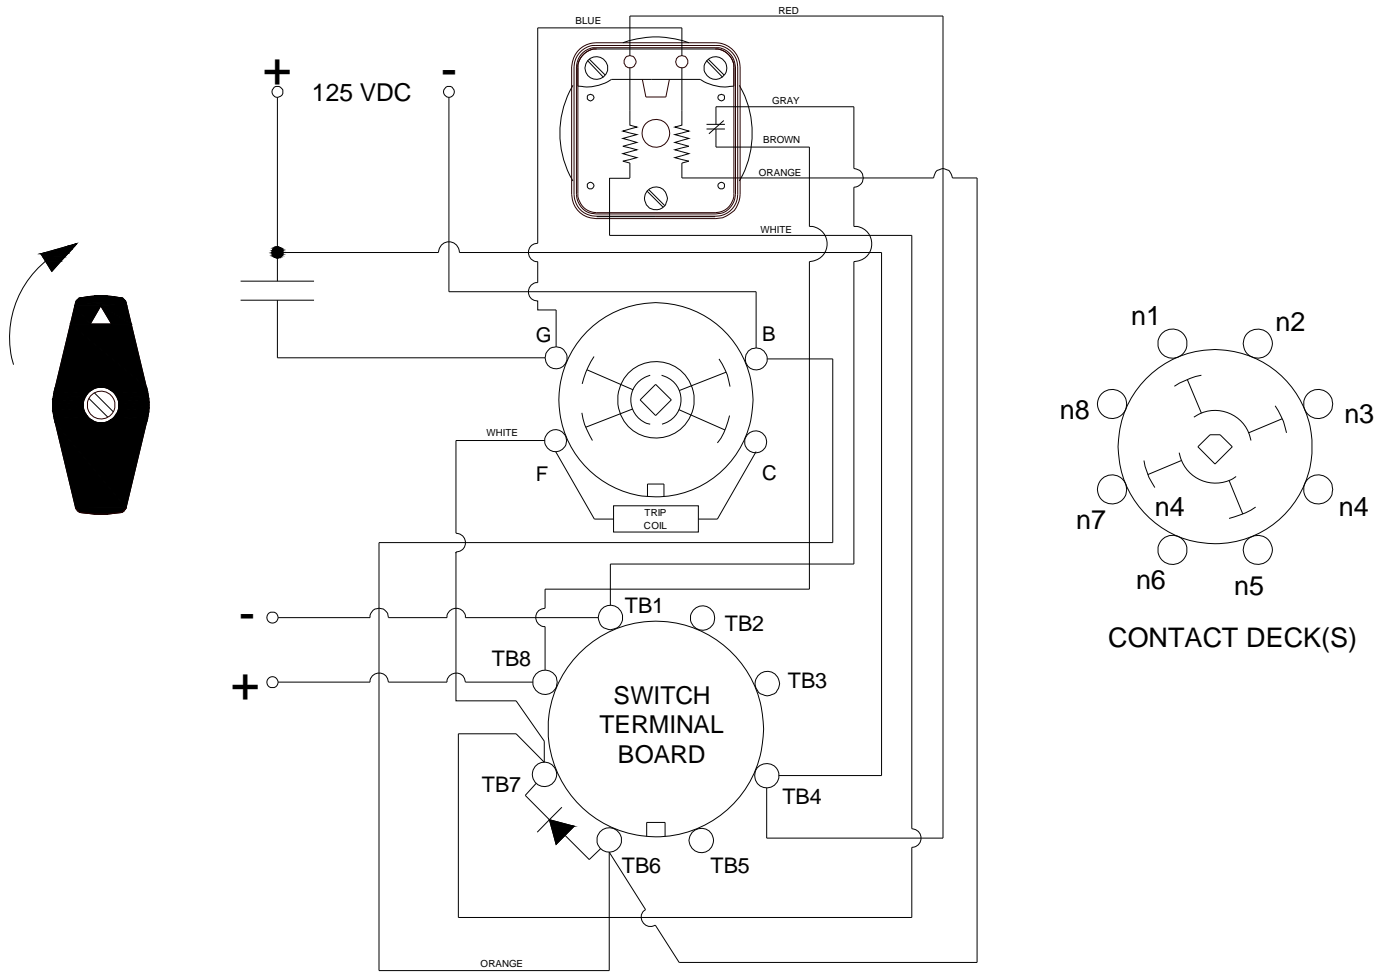

DESCRIPTION

LIGHTED ESCUTCHEON PANEL  
WIRING DIAGRAM

DRAWN P.DORMAN 8-7-08

SCALE .5X

PART NUMBER


**7604D 125VDCAXC**

REVISIONS					
LTR	DESCRIPTION	DATE	APP'D	DATE	APP'D

WHEN A PREDETERMINED CONDITION EXISTS, A SIGNAL WILL BE SENT TO S1 WHICH WILL ACTIVATE THE COIL AND CAUSE THE LOR TO "TRIP". THE "B" AND "G" CONTACTS ON THE CONTROL DECK PROVIDE THE CONNECTION TO THE CONTROL CIRCUIT THROUGH S1 WHICH CAN BE A CONTACT OF ANY TYPE I.E. SWITCH, RELAY.... THE LOR CONTACTS IN FIGURE "B" ARE IN THE "TRIPPED" POSITION.

THE LOR WILL REMAIN IN THE "TRIPPED" POSITION UNTIL MANUALLY RESET.

FIGURE B - TRIP POSITION

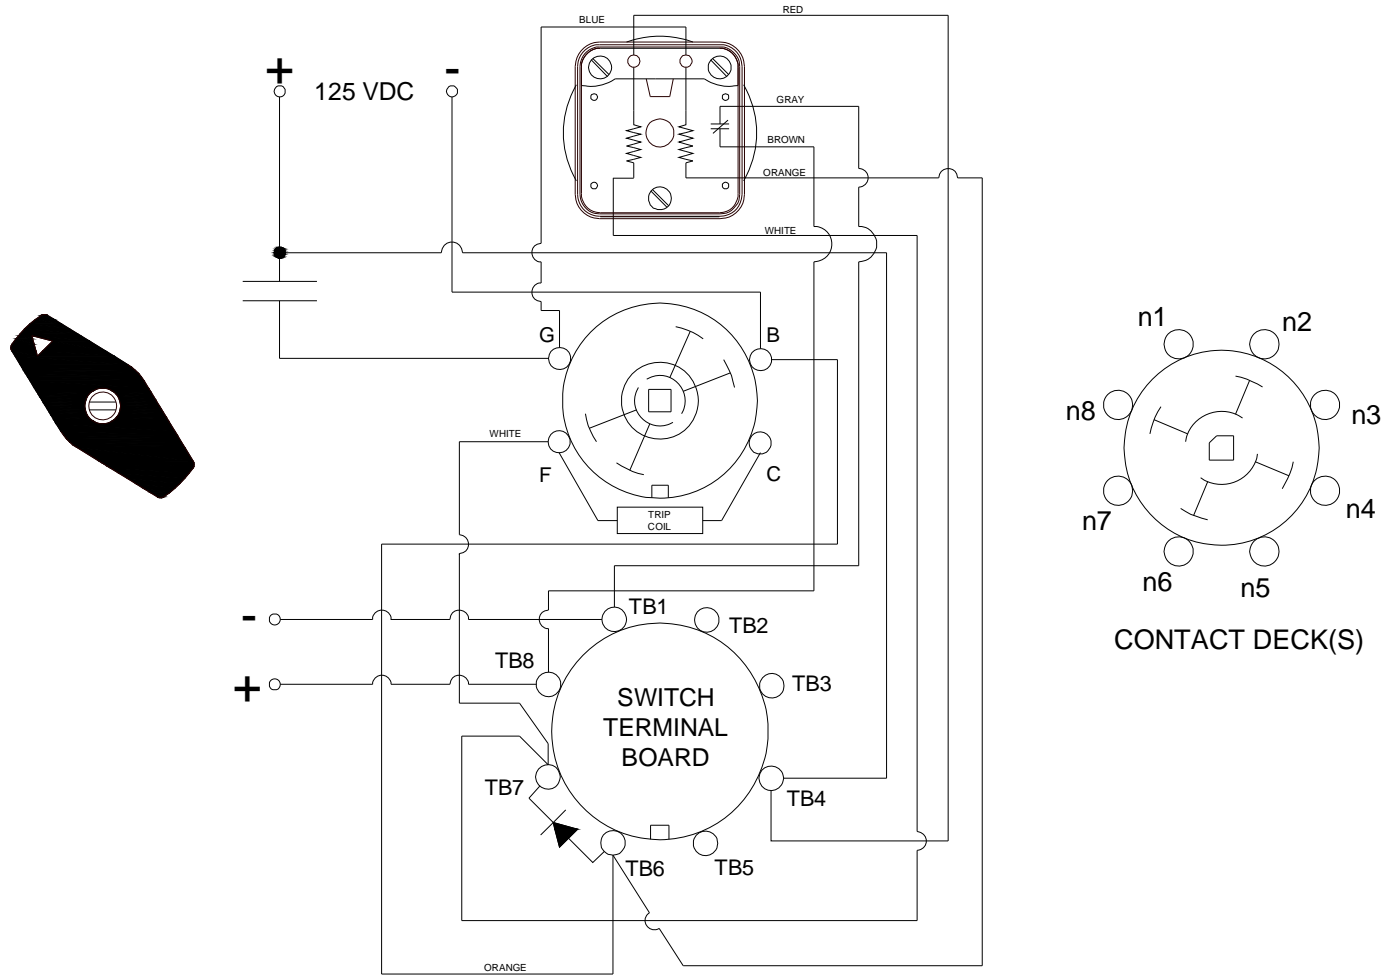

DESCRIPTION LIGHTED ESCUTCHEON PANEL  
WIRING DIAGRAM

DRAWN P.DORMAN 8-7-08  
SCALE .5X

PART NUMBER  
**7604D 125VDCAXC**